


FCOG6100 REV R ORDERING GUIDE

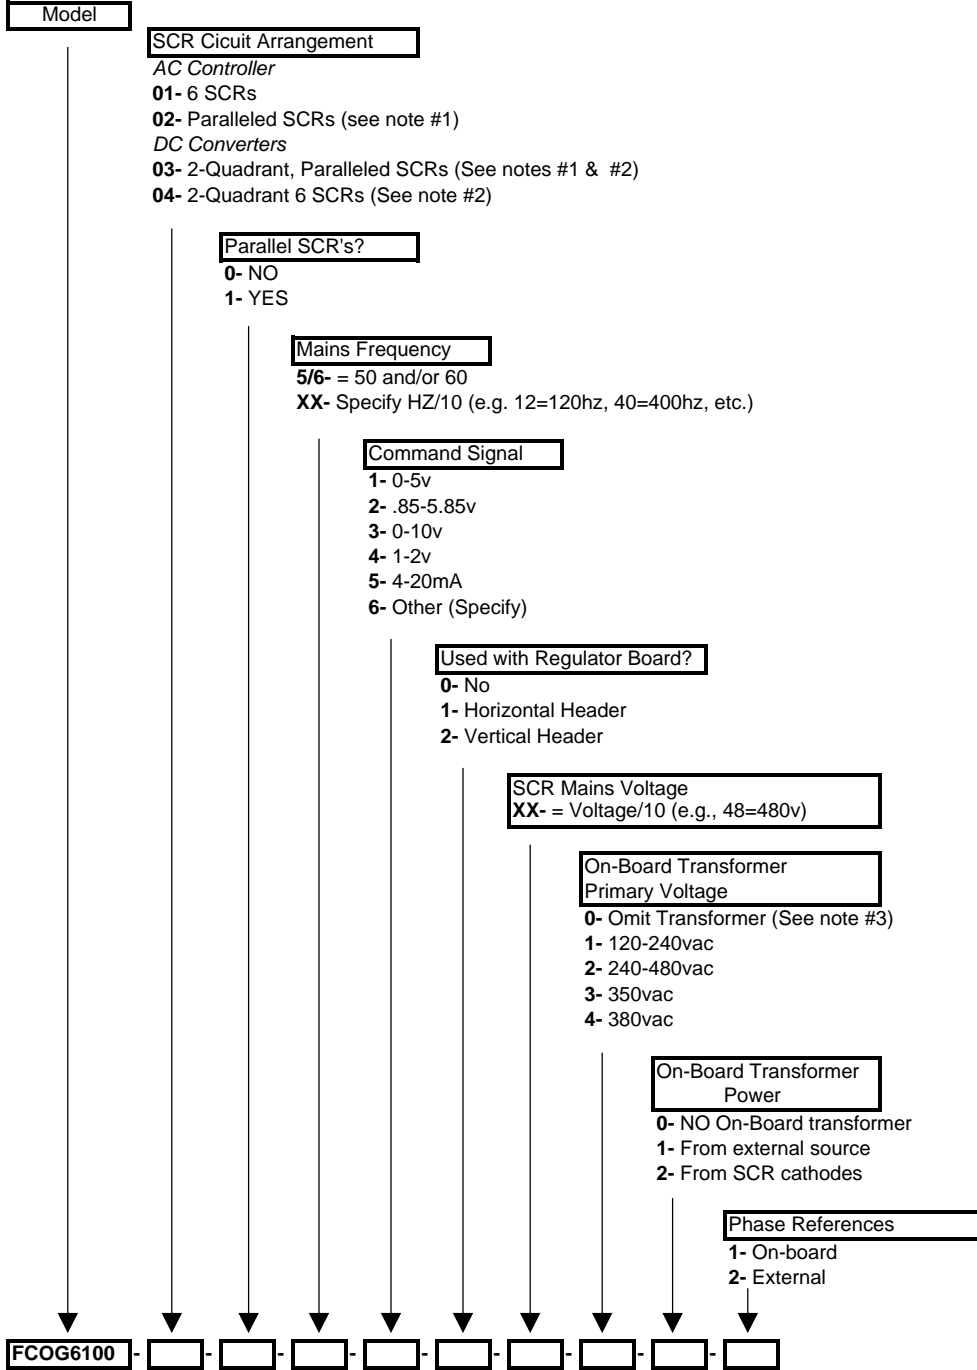

Note 1: Auxiliary Firing board required
 Note 2 - Specify circuit type on ordering documents
 Note 3 - 24vac or 30vdc customer supplied

Customer Name Date

Customer Comments Version 04-21-2009